

Commercial Titanium Split Cold Plunge Chiller

Standard Features

- U.L. Listed, EPA Compliant, Low GWP R454A eco-friendly condensing unit complies with latest codes
- Split chiller; outdoor condensing unit with indoor heat exchanger cabinet (requires a line set to be provided and installed by a refrigeration contractor to connect the two units together).
- Galvanized steel cabinet with high gloss powder coat finish
- Copeland scroll compressor with crankcase heater and freeze stat safety thermostat
- Condensing unit is suitable for outdoor installation with flooded condenser for low ambient operation down to -20°F
- Air cooled, high ambient, horizontal discharge condenser with head pressure control
- Oversized receiver with outlet shutoff valve and pressure safety
- Single point power connection into weather proof electrical panel
- Titanium coaxial tube-in-tube evaporator
- Control circuit with digital, electronic thermostat, compressor anti-short-cycle time delay, water flow safety switch lockout, and high and low refrigeration pressure safety lockout switches.
- Refrigerant leak detection sensor with corresponding compressor shut off
- Liquid line specialties include externally equalized thermal expansion valve with liquid line solenoid valve, filter drier, and sight glass
- Non ferrous water lines wrapped in 1/2" closed cell insulation to minimize condensation
- System is factory leak checked, pressure tested, put under a deep vacuum, charged with refrigerant, and functionally tested prior to shipment
- Warranty: One (1) years limited parts, five (5) years limited compressor warranty

Options & Accessories

- Condenser coil coating for corrosion protection in coastal areas
- Remote temperature control
- Heated & insulated receiver in condensing unit for cold weather operation
- Other voltages and options available; consult the factory
- Factory authorized technician for startup, training & service



Indoor Heat Exchanger



Outdoor Condensing Unit


Plunge Pool Chiller Sizing Guide			
Pool Volume (Gallons)	Chiller Capacity	Chiller H.P @ 50F LWT	Chiller H.P. @ 45F LWT
100 to 300	1 Ton	1.0	1.5
300 to 450	1-1/2 Ton	1.5	2.0
450 to 650	2 Ton	2.0	2.5
650 to 950	3 Ton	3.0	3.5
950 to 1,200	4 Ton	4.0	5.0
1,200 to 1,500	5 Ton	5.0	6.0
1,500 to 2,000	6 Ton	6.0	7.0
2,000 to 2,700	7 Ton	7.0	7.5
2,700 to 3,500	10 Ton	10.0	10.0

Consider Upsizing Chiller If...

- Piping runs are long, uninsulated or run under heated floors.
- Filter system adds heat
- Pool is used for long durations or repeatedly with minimum recovery time between usage.
- Pool is used for full body immersion
- Pool is in an outdoor or warm location
- Pool will be turned on/off with limited cool down period (may significantly increase chiller size - consult factory).

Our clients include many professional sports teams like the Oklahoma City Thunder, Denver Nuggets and Chicago Bears plus spa's, cruise ships and residences.

Typical Site Installation

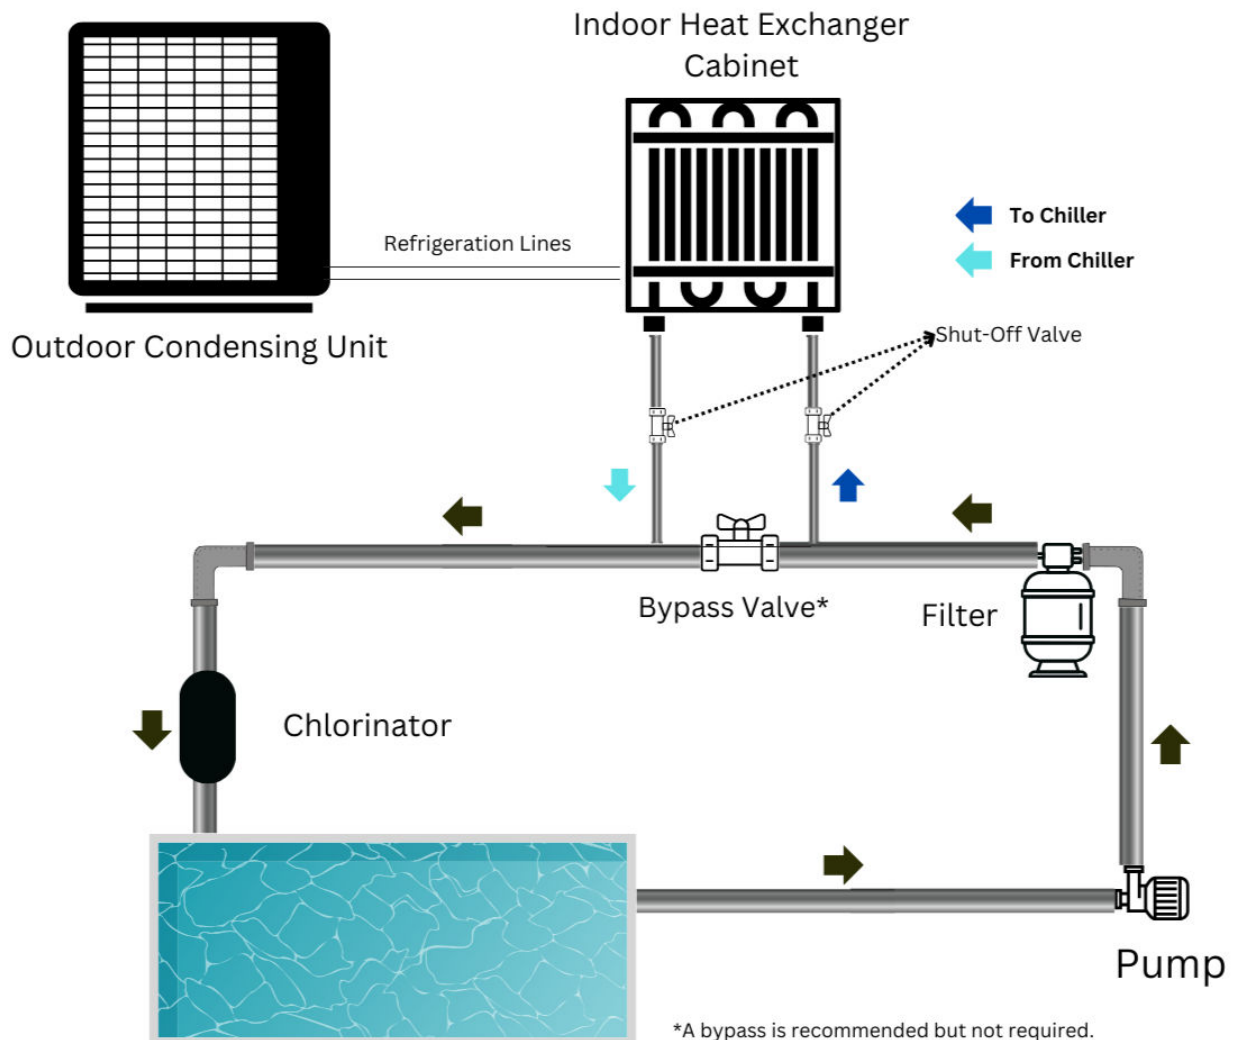

CPPCTI-SPLIT-R06 Series						
General Data						
Model (CPPC****TI-SPLIT-R06)	0151	0201	0301	0401	0501	
Nominal Tons Cooling	1.5	2	3	4	5	
Refrigerant	R454A	R454A	R454A	R454A	R454A	
Electrical Data						
Supply Power	Voltage	208-230	208-230	208-230	208-230	208-230
	Phase	1	1	1	1	1
	Frequency (Hz)	60	60	60	60	60
Compressor	Quantity	1	1	1	1	1
	Rated Load Amps (RLA)	12	15.7	23.2	26.1	31.1
	Locked Rotor Amps (LRA)	56	68	112	137	175
Fan Motor	Quantity	1	1	1	1	1
	Full Load Amps (FLA)	1.1	1.1	2.1	2.1	2.1
Total Circuit	Full Load Amps (FLA)	13.1	16.8	25.3	28.2	33.2
	Min Circuit Ampacity (MCA)	16.4	21	31.6	35.3	41.5
	Max Overcurr. Protect. (MOP)	25	35	50	60	70
Physical Data						
Outdoor Unit Size (in)	Length (L)	37	37	44	44	44
	Width (W)	31	31	33	33	33
	Height (H)	20	20	30.5	30.5	30.5
Indoor Unit Size (in)	Length (L)	32	32	30	30	30
	Width (W)	12	12	25	25	25
	Height (H)	24	24	34	34	44
Weight (lb)	Outdoor	240	255	385	410	515
	Indoor	105	105	150	150	200
	Ship	545	560	835	860	1015
Clearances (in)	Air Intake	20	20	30.5	30.5	30.5
	Air Discharge	40	40	61	61	61
	Service (Sides)	24	24	24	24	24
Connection Sizes (in)	Water	1.5 FPT	1.5 FPT	2 Union	2 Union	2 Union
	Refrig. Liquid Line OD	3/8	3/8	1/2	1/2	1/2
	Refrig. Suction Line OD	7/8	7/8	7/8	1-1/8	1-1/8
Flow Rate (GPM)	Maximum Flow Rate	40	40	55	55	75
	Minimum Flow Rate	20	20	25	25	50

*All specs are subject to change without notice

CPPCTI-SPLIT-R06 Series							
General Data							
Model (CPPC****TI-SPLIT-R06)	0153	0203	0303	0403	0503	0753	
Nominal Tons Cooling	1.5	2	3	4	5	7.5	
Refrigerant	R454A	R454A	R454A	R454A	R454A	R454A	
Electrical Data							
Supply Power	Voltage	208-230	208-230	208-230	208-230	208-230	208-230
	Phase	3	3	3	3	3	3
	Frequency (Hz)	60	60	60	60	60	60
Compressor	Quantity	1	1	1	1	1	1
	Rated Load Amps (RLA)	9.7	10.6	15.2	20.5	22.1	35.5
	Locked Rotor Amps (LRA)	58	58	93	114	128	224
Fan Motor	Quantity	1	1	1	1	1	2
	Full Load Amps (FLA)	1.1	1.1	2.1	2.1	2.1	4.2
Total Circuit	Full Load Amps (FLA)	10.8	11.7	17.3	22.6	24.2	43.9
	Min Circuit Ampacity (MCA)	13.5	14.6	21.6	28.3	30.3	54.9
	Max Overcurr. Protect. (MOP)	20	20	35	40	50	80
Physical Data							
Outdoor Unit Size (in)	Length (L)	37	37	44	44	44	65.5
	Width (W)	31	31	33	33	33	36
	Height (H)	20	20	30.5	30.5	30.5	42
Indoor Unit Size (in)	Length (L)	32	32	30	30	30	30
	Width (W)	12	12	25	25	25	25
	Height (H)	24	24	34	34	44	54
Weight (lb)	Outdoor	240	255	385	410	515	615
	Indoor	105	105	150	150	200	200
	Ship	645	660	835	860	1015	1115
Clearances (in)	Air Intake	20	20	30.5	30.5	30.5	42
	Air Discharge	40	40	61	61	61	84
	Service (Sides)	24	24	24	24	24	24
Connection Sizes (in)	Water	1.5 FPT	1.5 FPT	2 Union	2 Union	2 Union	2 Union
	Refrig. Liquid Line OD	3/8	3/8	1/2	1/2	1/2	5/8
	Refrig. Suction Line OD	7/8	7/8	7/8	1-1/8	1-1/8	1-3/8
Flow Rate (GPM)	Maximum Flow Rate	40	40	55	55	75	75
	Minimum Flow Rate	20	20	25	25	50	50

*All specs are subject to change without notice

CPPCTI-SPLIT-R06 Series						
General Data						
Model (CPPC****TI-SPLIT-R06)	0304	0404	0504	0604	0754	
Nominal Tons Cooling	3	4	5	6	7.5	
Refrigerant	R454A	R454A	R454A	R454A	R454A	
Electrical Data						
Supply Power	Voltage	460	460	460	460	460
	Phase	3	3	3	3	3
	Frequency (Hz)	60	60	60	60	60
Compressor	Quantity	1	1	1	1	1
	Rated Load Amps (RLA)	6.9	9.4	9.6	10.1	15.2
	Locked Rotor Amps (LRA)	48	58	63	75	99
Fan Motor	Quantity	1	1	1	1	2
	Full Load Amps (FLA)	1.1	1.1	1.1	1.1	2.1
Total Circuit	Full Load Amps (FLA)	8	10.5	10.7	11.2	19.4
	Min Circuit Ampacity (MCA)	10	13.1	13.4	14	24.3
	Max Overcurr. Protect. (MOP)	15	20	20	20	35
Physical Data						
Outdoor Unit Size (in)	Length (L)	44	44	44	52.5	65.5
	Width (W)	33	33	33	36	36
	Height (H)	30.5	30.5	30.5	42	42
Indoor Unit Size (in)	Length (L)	30	30	30	30	30
	Width (W)	25	25	25	25	25
	Height (H)	34	34	44	54	54
Weight (lb)	Outdoor	385	410	515	603	615
	Indoor	150	150	200	200	200
	Ship	835	860	1015	1103	1115
Clearances (in)	Air Intake	30.5	30.5	30.5	42	42
	Air Discharge	61	61	61	84	84
	Service (Sides)	24	24	24	24	24
Connection Sizes (in)	Water	2 Union	2 Union	2 Union	2 Union	2 Union
	Refrig. Liquid Line OD	1/2	1/2	1/2	5/8	5/8
	Refrig. Suction Line OD	7/8	1-1/8	1-1/8	1-3/8	1-3/8
Flow Rate (GPM)	Maximum Flow Rate	55	55	75	75	75
	Minimum Flow Rate	25	25	50	50	50

*All specs are subject to change without notice

CPPC Refrigerant Line Sizing R454A (35°F SST)								
Nominal Capacity per stage (BTU/h)	Single Stage Model	Equivalent Length	0-25'	26-50'	51-75'	76-100'	101-125'	126-150'
		Estimated Linear Length (ft)	0-20'	21-40'	41-60'	61-80'	81-100'	101-120'
18,000	015	Liquid Line (in - OD)	3/8	3/8	3/8	3/8	3/8	1/2
		Suction Line (in - OD)	5/8	7/8	7/8	7/8	7/8	7/8
		Base Unit Charge (lb)	11	11	11	11	11	11
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	0.0	0.0	5.2
		Estimated Total System Charge (lb)	11.0	11.0	11.0	11.0	11.0	16.2
24,000	020	Liquid Line (in - OD)	3/8	3/8	3/8	1/2	1/2	1/2
		Suction Line (in - OD)	7/8	7/8	7/8	7/8	7/8	7/8
		Base Unit Charge (lb)	11	11	11	11	11	11
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	2.0	3.9	5.7
		Estimated Total System Charge (lb)	11.0	11.0	11.0	13.0	14.9	16.7
36,000	030	Liquid Line (in - OD)	3/8	1/2	1/2	1/2	1/2	1/2
		Suction Line (in - OD)	7/8	7/8	7/8	1-1/8	1-1/8	1-1/8
		Base Unit Charge (lb)	22	22	22	22	22	22
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	0.0	0.0	0.0
		Estimated Total System Charge (lb)	22.0	22.0	22.0	22.0	22.0	22.0
48,000	040	Liquid Line (in - OD)	1/2	1/2	1/2	1/2	1/2	5/8
		Suction Line (in - OD)	7/8	7/8	1-1/8	1-1/8	1-1/8	1-1/8
		Base Unit Charge (lb)	22	22	22	22	22	22
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	0.0	0.7	8.6
		Estimated Total System Charge (lb)	22.0	22.0	22.0	22.0	22.7	30.6
54,000	050	Liquid Line (in - OD)	1/2	1/2	1/2	1/2	1/2	5/8
		Suction Line (in - OD)	7/8	7/8	1-1/8	1-1/8	1-1/8	1-3/8
		Base Unit Charge (lb)	22	22	22	22	22	22
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	0.0	1.3	10.4
		Estimated Total System Charge (lb)	22.0	22.0	22.0	22.0	23.3	32.4
66,000	060	Liquid Line (in - OD)	1/2	1/2	5/8	5/8	5/8	5/8
		Suction Line (in - OD)	7/8	1-1/8	1-1/8	1-3/8	1-3/8	1-3/8
		Base Unit Charge (lb)	30	30	30	30	30	30
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	2.3	5.5	8.7
		Estimated Total System Charge (lb)	30.0	30.0	30.0	32.3	35.5	38.7
84,000	075	Liquid Line (in - OD)	5/8	5/8	5/8	5/8	5/8	5/8
		Suction Line (in - OD)	1-1/8	1-1/8	1-3/8	1-3/8	1-3/8	1-3/8
		Base Unit Charge (lb)	54	54	54	54	54	54
		Line Set Additional Charge required (lb)	0.0	0.0	0.0	0.0	0.0	0.0
		Estimated Total System Charge (lb)	54.0	54.0	54.0	54.0	54.0	54.0

Legend	Description
Equivalent Length	Equivalent tubing length, including effects of refrigeration specialties devices
Estimated Linear Length	Linear tubing length, feet (actual linear length will vary based on site conditions)
Base Unit Charge (lb)	Outdoor unit base refrigerant charge. Factory charged to this level.
Line Set Additional Charge reqd (lb)	Additional refrigerant charge based on line set length. To be charged by contractor & noted on outdoor unit.
Estimated Total System Charge (lb)	Estimated total required refrigerant charge
Notes	For applications with equivalent length greater than 150 ft (57 m) and/or linear length greater than 120 ft, contact American Chillers. *Follow all standard refrigeration practices for piping layout. For more details please see Installation and Maintenance Manual.

A2L Installation Requirements

R-454B, R454A and R32 are classified by UL 60335-2-40 and ASHRAE 34 as **mildly flammable A2L refrigerants**. According to the UL standard, mitigation is required when the amount of refrigerant used indoors could lead to concentrations that exceed **25% of the Lower Flammability Limit (LFL)** in the event of a leak.

Mitigation can be handled in one of the following ways:

1. **Adequate Room Volume:** The mechanical room must be large enough (A_{min}) that a full refrigerant leak would not exceed the safety threshold. This option requires no fans or detection equipment, provided sufficient room volume.
2. **Mechanical Ventilation:** If the space is not large enough, continuous mechanical ventilation to the outdoors can be used to safely dilute any potential refrigerant leaks. The ventilation system must meet minimum airflow levels (Q_{min}) based on the refrigerant charge.

In many states and local codes, a **Refrigerant Detection System (RDS)** is required, especially when ventilation is not continuous or when isolation valves are not used.

American Chillers provides an integrated RDS that includes:

- A refrigerant sensor installed near the indoor evaporator
- A controller that automatically shuts down the compressor and closes the liquid line valve if refrigerant levels exceed a safe threshold
- A lockout feature that prevents restart until the refrigerant level returns to normal
- Field-replaceable components that can be serviced/tested without replacing full unit

Releasable Refrigerant Charge (lbs)	Minimum Area (ft ²) for an <u>Unventilated Space</u>			Minimum Air Flow (CFM) for a <u>Ventilated space*</u>		
	R454B (ft ²)	R454A (ft ²)	R32 (ft ²)	R454B (CFM)	R454A (CFM)	R32 (CFM)
4	62	69	65	132	137	130
6	93	103	98	198	206	195
8	123	137	130	264	275	261
10	154	172	163	330	344	326
12	185	206	195	396	412	391
16	247	275	260	528	550	521
18	278	309	293	594	619	586
22	340	378	358	726	756	717
26	401	446	423	858	893	847
30	463	515	488	990	1031	977
35	540	601	570	1155	1203	1140
40	617	687	651	1320	1375	1303
45	694	773	732	1485	1546	1466
50	772	859	814	1650	1718	1629
55	849	944	895	1815	1890	1792